

The ACX-100 input/output expansion module interfaces with the ACU-100 wireless system controller. It enables the system to be expanded by additional 8 outputs and 4 control inputs. The ACU-100 controller accepts up to five ACX-100 modules. Both the outputs and the control inputs have the same features as in the ACU-100 controller.

1. DESCRIPTION OF ELECTRONICS BOARD

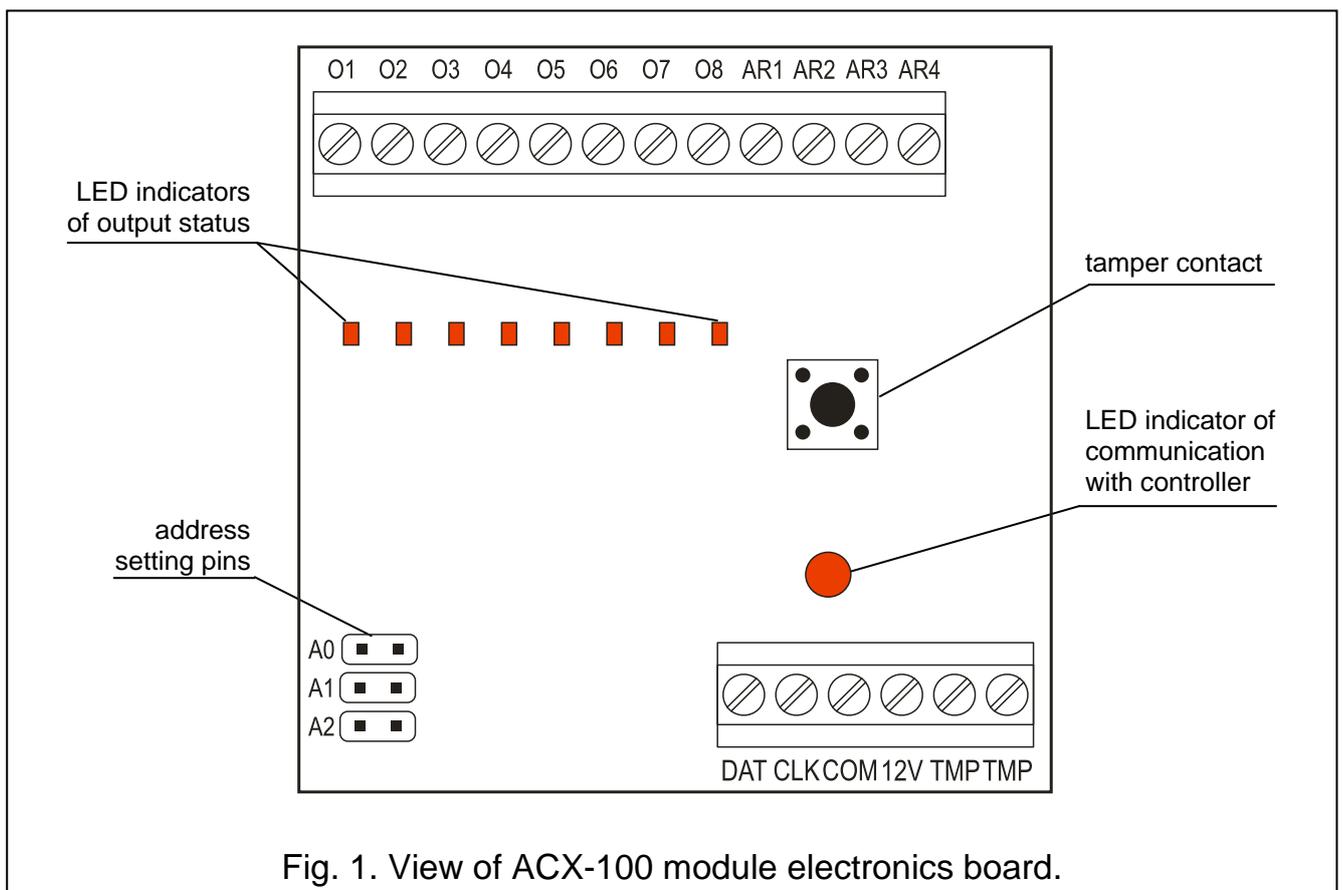


Fig. 1. View of ACX-100 module electronics board.

Description of terminals:

- O1...O8** – outputs of information on state of wireless devices
- AR1...AR4** – control inputs
- DAT, CLK** – communication bus
- COM** – common (ground)
- 12V** – supply input
- TMP** – tamper contact terminals of the module (NC)

The tamper contact reacts to opening of the module housing. The tamper contact terminals can be connected to the tamper circuit of the control panel.

The communication bus (CLK, DAT) of the module enables connection to the ACU-100 controller communication bus. If the ACX-100 module is connected to the

controller, the controller cannot be connected to the control panel through the communication bus.

The LED indicator situated at the communication bus terminals indicates by blinking the communication with the ACU-100 controller. The blinking frequency depends on the number of ACX-100 modules connected to the controller: it gets slower as the number of modules increases. If there is no communication with the controller, the LED is constantly on and, additionally, all the LEDs indicating the status of outputs come on.

The pins A0, A1 and A2 are used for setting an individual address of the module (see Table 1). Each ACX-100 module connected to the ACU-100 controller must have a different address from the 0–4 range (if a higher address is set, it will be read as 4). The address must correspond to the number of a module in the system according to Table 2. If one ACX-100 module is connected to the controller, it requires the address 0, if two – one of them requires the address 0 to be set, and the other – the address 1, etc.

| Pins | A0 | A1 | A2 |
|--------------------------------------|----|----|----|
| Numerical value (with jumper set) | 1 | 2 | 4 |

Table 1.

| Consecutive module number | Module address | Pins | | |
|---------------------------|----------------|---|---|---|
| | | A0 | A1 | A2 |
| 1 | 0 |  |  |  |
| 2 | 1 |  |  |  |
| 3 | 2 |  |  |  |
| 4 | 3 |  |  |  |
| 5 | 4 |  |  |  |

 – pins shorted

 – pins open

Table 2.

The method of numbering the outputs and control inputs of the ACX-100 modules in the wireless system is described in the ACU-100 controller manual.

2. INSTALLATION

The ACX-100 module should be installed indoors, in spaces with a normal air humidity. It is recommended that all connections be made with power supply disconnected.

In view of the necessity to connect the module outputs/inputs with the alarm control panel, it is advisable to install the module in the vicinity of the control panel. Thus the length of the cables connecting the module with the panel will be minimized.

Note: For compliance with the requirements of EN50131-3, the ACX-100 module shall be installed in the control panel housing.

For further information regarding operation of the ACX-100 module in the wireless system and use of the outputs and control inputs please refer to the ACU-100 controller manual.

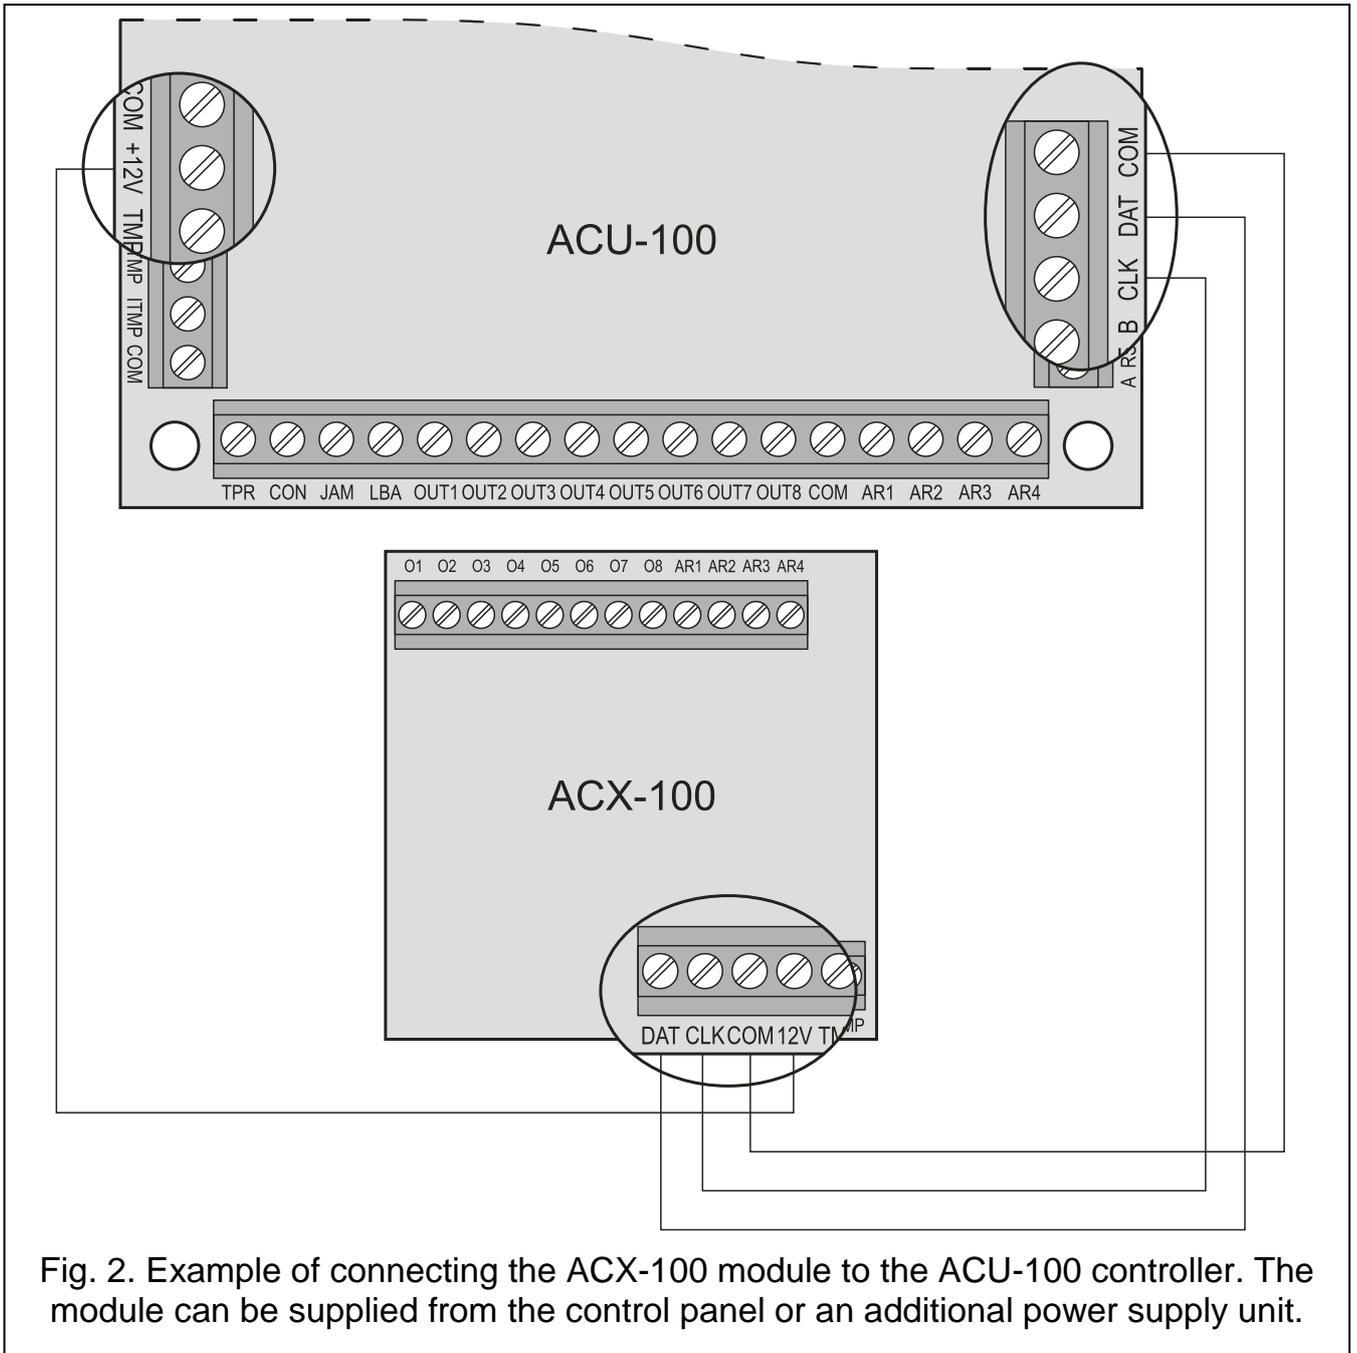


Fig. 2. Example of connecting the ACX-100 module to the ACU-100 controller. The module can be supplied from the control panel or an additional power supply unit.

3. SPECIFICATIONS

| | |
|--|--|
| Supply voltage | 12 V DC \pm 15% |
| Current consumption, standby..... | 70 mA |
| Current consumption, maximum..... | 70 mA |
| Outputs rating | 50 mA |
| Security grade according to EN50131-3 | Grade 2 |
| Environmental class according to EN50130-5 | II |
| Operating temperature range | -10°C...+55°C |
| Maximum humidity..... | 93 \pm 3% |
| Complied with standards | EN 50130-4, EN 50130-5, EN 50131-1, EN 50131-3 |
| Housing dimensions | 72x118x24 mm |
| Weight | 65 g |
| Name of certification body | Telefication |

| DECLARATION OF CONFORMITY | | CE1471 |
|---|---|---|
| Product: ACX-100 – Expander of ABAX Wireless System Controller | Manufacturer: SATEL spółka z o.o. ul. Schuberta 79 80-172 Gdańsk, POLAND tel. (+48 58) 320-94-00 fax. (+48 58) 320-94-01 | |
| Product description: Expansion module connected directly to ACU-100 wireless controller unit for increasing the number of inputs/outputs of a controller. Device is intended for installation in intruder alarm systems. | | |
| This product conforms to the following EU Directives: R&TTE 1999/5/EC | | |
| This product meets requirements of the harmonized standards: EMC: ETSI EN 301 489-1: v.1.5.1.; EN 301 489-3: v.1.4.1 Safety: EN60950-1:2004 | | |
| Notified body taking part in conformity evaluation: Identification No.: 1471 | | |
| Gdańsk, Poland 2005-07-15 | Head of Test Laboratory: Michał Konarski |  |
| The latest EC declaration of conformity and product approval certificates are available for downloading on our website www.satel.pl | | |

SATEL sp. z o.o.
 ul. Schuberta 79
 80-172 Gdańsk
 POLAND
 tel. + 48 58 320 94 00
 info@satel.pl
 www.satel.pl